


Four Creeks School - Room 402

Date/Time	Radon (pCi/l)
12/31/2019 15:26	0.7
12/31/2019 16:26	1.3
12/31/2019 17:26	0.3
12/31/2019 18:26	0
12/31/2019 19:26	0.7
12/31/2019 20:26	1.3
12/31/2019 21:26	1
12/31/2019 22:26	0.7
12/31/2019 23:26	0.7
1/1/2020 0:26	1
1/1/2020 1:26	0
1/1/2020 2:26	0.7
1/1/2020 3:26	1
1/1/2020 4:26	1.3
1/1/2020 5:26	1
1/1/2020 6:26	0.7
1/1/2020 7:26	0
1/1/2020 8:26	0.7
1/1/2020 9:26	0.3
1/1/2020 10:26	0.3
1/1/2020 11:26	0.7
1/1/2020 12:26	1.3
1/1/2020 13:26	0.7
1/1/2020 14:26	0.7
1/1/2020 15:26	0
1/1/2020 16:26	0
1/1/2020 17:26	0.7
1/1/2020 18:26	0.3
1/1/2020 19:26	1.7
1/1/2020 20:26	0.7
1/1/2020 21:26	0.7
1/1/2020 22:26	2
1/1/2020 23:26	0.7
1/2/2020 0:26	0.7
1/2/2020 1:26	1
1/2/2020 2:26	4.5
1/2/2020 3:26	2.8
1/2/2020 4:26	2.8
1/2/2020 5:26	1.7
1/2/2020 6:26	1.7
1/2/2020 7:26	0.7
1/2/2020 8:26	2.8
1/2/2020 9:26	5.3
1/2/2020 10:26	2
1/2/2020 11:26	1
1/2/2020 12:26	0.7
1/2/2020 13:26	3.5
1/2/2020 14:26	3.5
1/2/2020 15:26	2.4
1/2/2020 16:26	2.4
1/2/2020 17:26	2.4
1/2/2020 18:26	2.4
1/2/2020 19:26	1
1/2/2020 20:26	2
1/2/2020 21:26	1.7
1/2/2020 22:26	1
1/2/2020 23:26	1.7
1/3/2020 0:26	2
1/3/2020 1:26	3.5
1/3/2020 2:26	2.8
1/3/2020 3:26	2
1/3/2020 4:26	2
1/3/2020 5:26	3.1
1/3/2020 6:26	2.4
1/3/2020 7:26	3.1
1/3/2020 8:26	4.1
1/3/2020 9:26	3.5
1/3/2020 10:26	4.9
1/3/2020 11:26	4.9
1/3/2020 12:26	4.5
1/3/2020 13:26	3.5
1/3/2020 14:26	2.4

Average Radon Concentration (pCi/l): 1.7

Average Radon Concentration Occupied Hours(pCi/l): 2.1

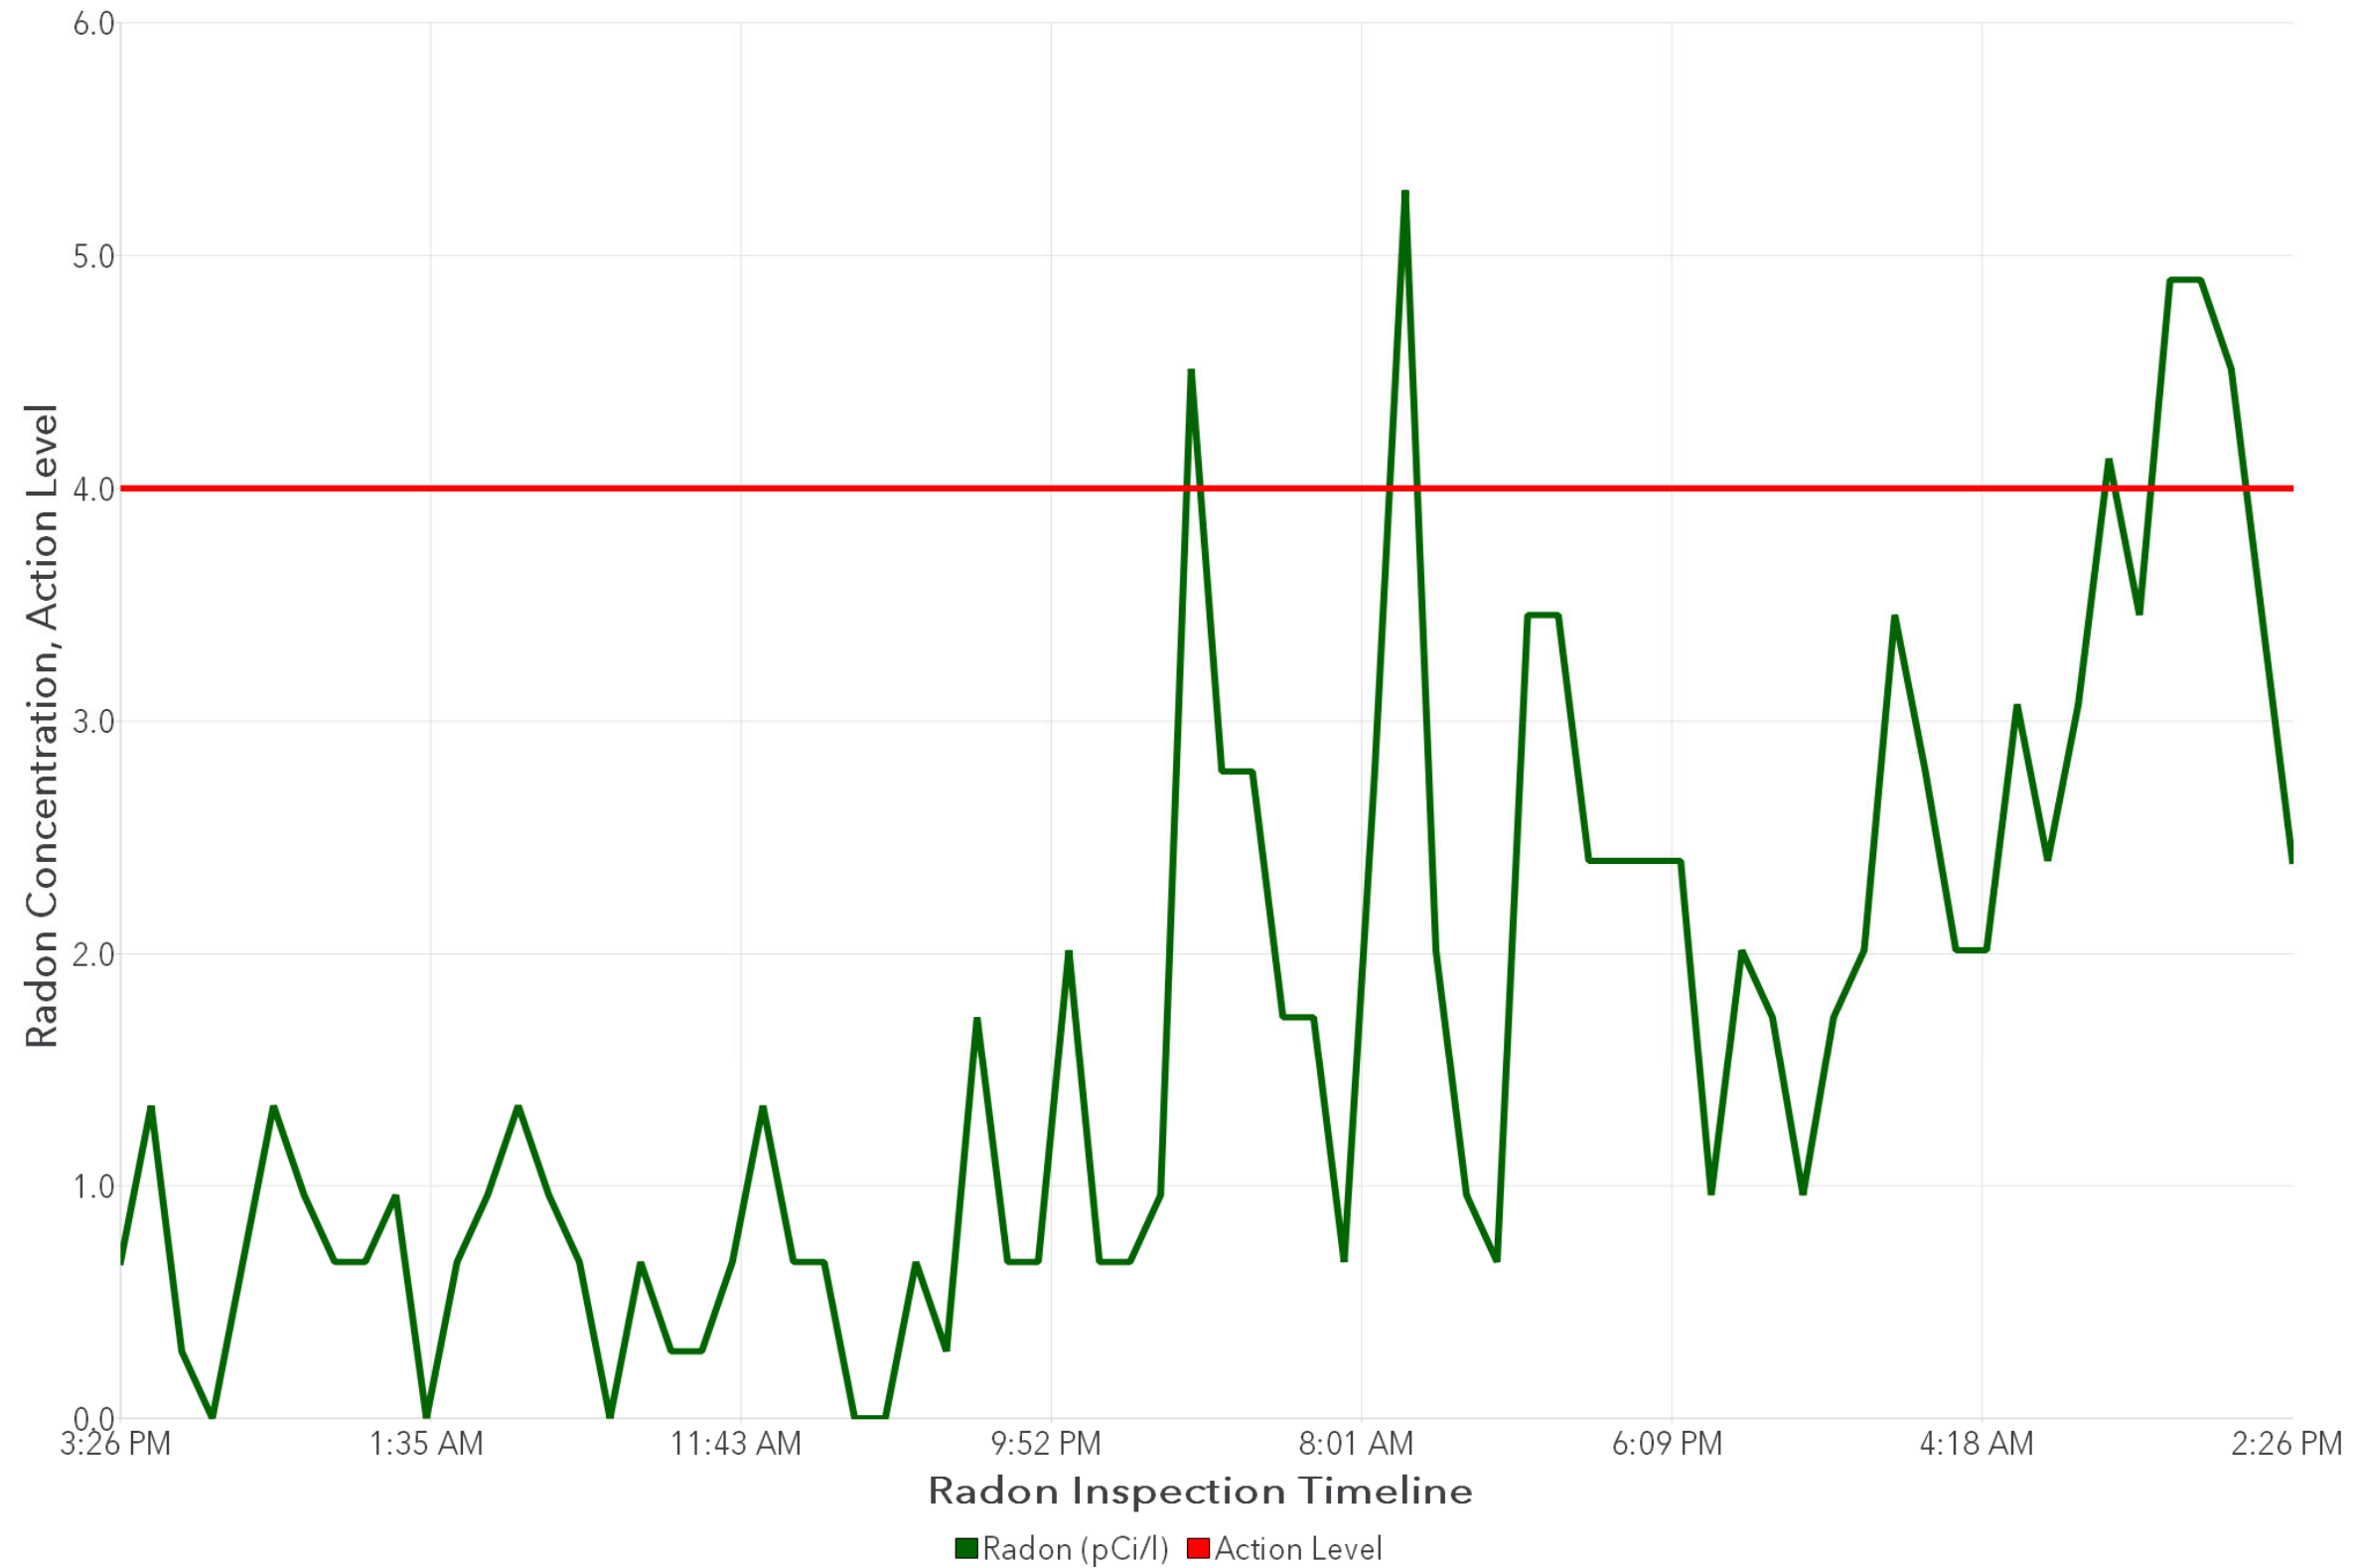


Four Creeks School - Room 405

Date/Time	Radon (pCi/l)
12/31/2019 15:41	1.6
12/31/2019 16:41	1
12/31/2019 17:41	1
12/31/2019 18:41	0.6
12/31/2019 19:41	0.3
12/31/2019 20:41	1
12/31/2019 21:41	0.6
12/31/2019 22:41	0.3
12/31/2019 23:41	0.6
1/1/2020 0:41	1.6
1/1/2020 1:41	1.3
1/1/2020 2:41	2.1
1/1/2020 3:41	1.6
1/1/2020 4:41	1.3
1/1/2020 5:41	1.6
1/1/2020 6:41	2.4
1/1/2020 7:41	1
1/1/2020 8:41	0.6
1/1/2020 9:41	0.3
1/1/2020 10:41	0
1/1/2020 11:41	1
1/1/2020 12:41	0.3
1/1/2020 13:41	1.3
1/1/2020 14:41	1.6
1/1/2020 15:41	1.6
1/1/2020 16:41	0.3
1/1/2020 17:41	0.6
1/1/2020 18:41	1.3
1/1/2020 19:41	1.6
1/1/2020 20:41	3.1
1/1/2020 21:41	0
1/1/2020 22:41	1
1/1/2020 23:41	1
1/2/2020 0:41	0.6
1/2/2020 1:41	1.3
1/2/2020 2:41	2.4
1/2/2020 3:41	3.1
1/2/2020 4:41	2.1
1/2/2020 5:41	2.1
1/2/2020 6:41	0.6
1/2/2020 7:41	1.3
1/2/2020 8:41	0
1/2/2020 9:41	1.3
1/2/2020 10:41	1
1/2/2020 11:41	1.6
1/2/2020 12:41	1
1/2/2020 13:41	3.7
1/2/2020 14:41	1.6
1/2/2020 15:41	0.6
1/2/2020 16:41	3.1
1/2/2020 17:41	3.1
1/2/2020 18:41	1.3
1/2/2020 19:41	1.3
1/2/2020 20:41	2.4
1/2/2020 21:41	1.3
1/2/2020 22:41	2.4
1/2/2020 23:41	2.7
1/3/2020 0:41	2.1
1/3/2020 1:41	1
1/3/2020 2:41	1.6
1/3/2020 3:41	2.1
1/3/2020 4:41	1.3
1/3/2020 5:41	3.1
1/3/2020 6:41	4.4
1/3/2020 7:41	1.3
1/3/2020 8:41	2.4
1/3/2020 9:41	6.5
1/3/2020 10:41	3.4
1/3/2020 11:41	3.7
1/3/2020 12:41	1.3
1/3/2020 13:41	3.4
1/3/2020 14:41	3.1

Average Radon Concentration (pCi/l): 1.6

Average Radon Concentration Occupied Hours(pCi/l): 1.7

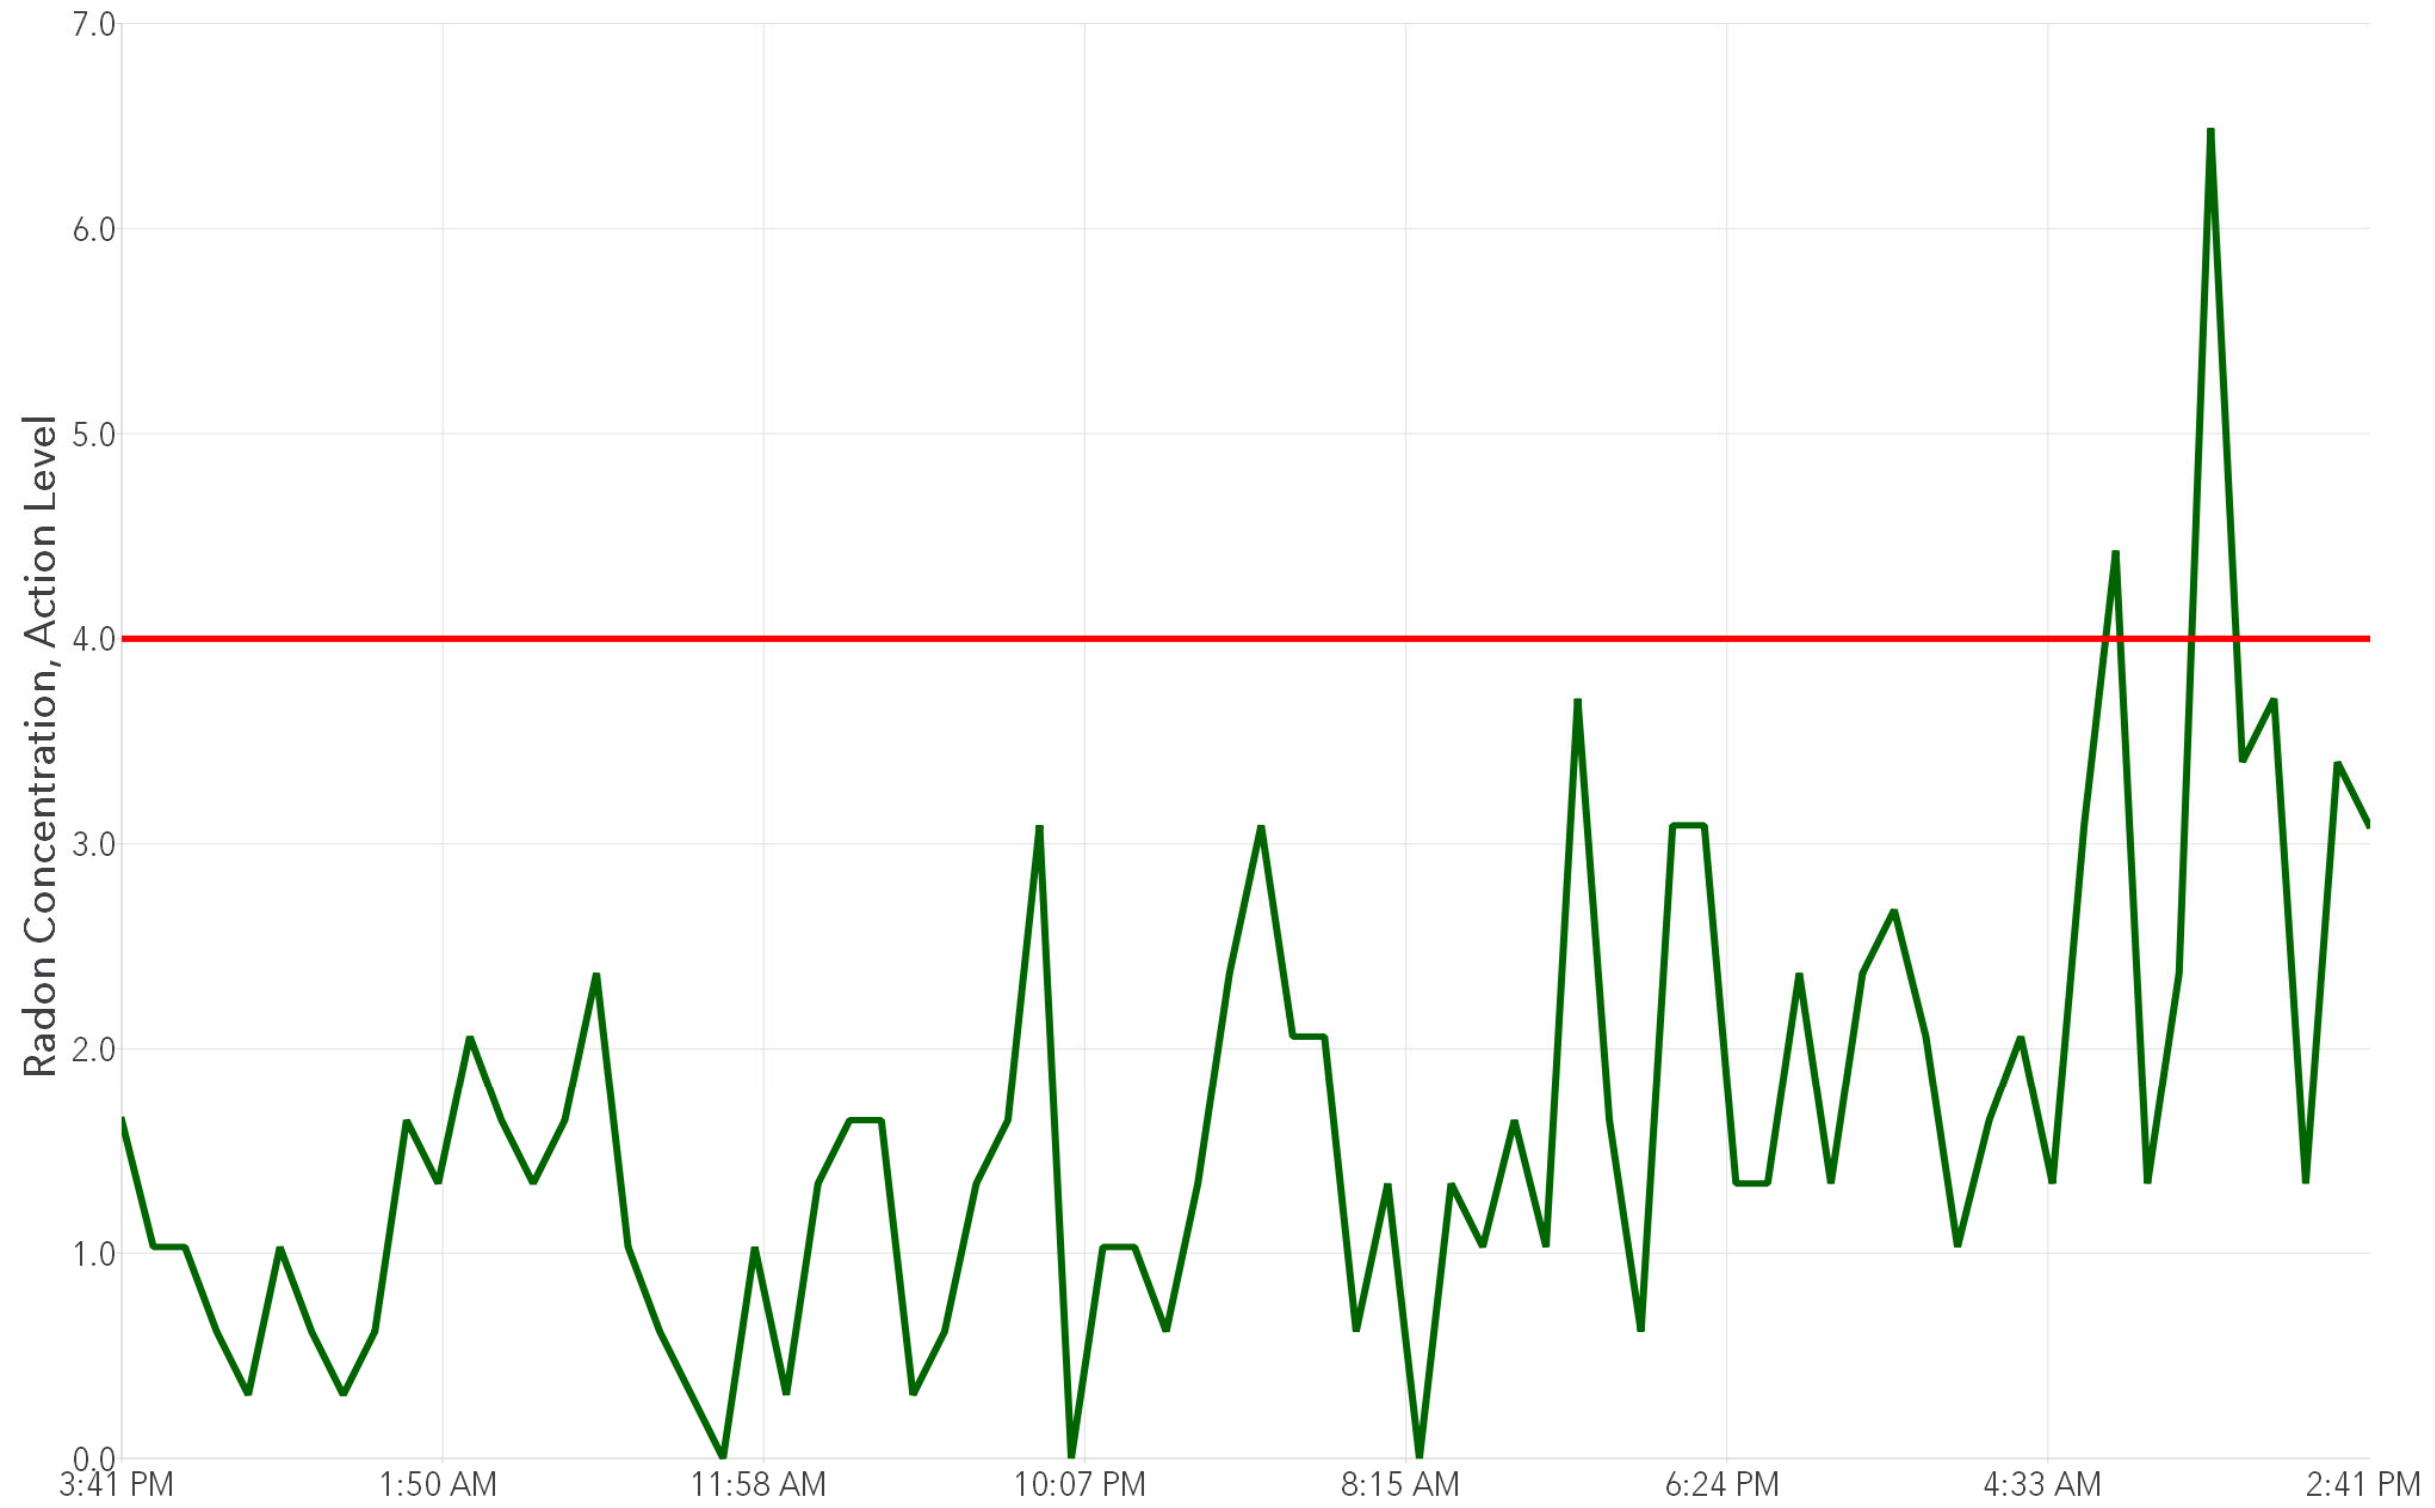

Radon Inspection Timeline

■ Radon (pCi/l) ■ Action Level

**P2446 / BOB KLECKNER**

<b>Kit Number</b>	<b>Start Date</b>	<b>Start Time</b>	<b>End Date</b>	<b>End Time</b>	<b>Temp.</b>	<b>Facility</b>	<b>Building</b>	<b>Room</b>	<b>Project ID</b>	<b>Floor</b>	<b>Result</b>
9336911	2019-12-30	2:00 pm	2020-01-03	3:00 pm	70	FOUR CREEKS	MAIN	PRINCIPAL'S OFFICE - DUPLICATE	23514.025 PHASE 0003	1	2.8
9336912	2019-12-30	2:00 pm	2020-01-03	3:00 pm	70	FOUR CREEKS	MAIN	PRINCIPAL'S OFFICE	23514.025 PHASE 0003	1	2.8
9336917	2019-12-31	2:00 pm	2020-01-03	3:00 pm	70	FOUR CREEKS	MAIN	405 SENSORY	23514.025 PHASE 0003	1	1.8
9336918	2019-12-31	2:00 pm	2020-01-03	3:00 pm	70	FOUR CREEKS	MAIN	404 BLANK	23514.025 PHASE 0003	1	< 0.3
9336919	2019-12-31	2:00 pm	2020-01-03	3:00 pm	70	FOUR CREEKS	MAIN	404 SENSORY	23514.025 PHASE 0003	1	1.7
9336920	2019-12-31	2:00 pm	2020-01-03	3:00 pm	70	FOUR CREEKS	MAIN	404	23514.025 PHASE 0003	1	1.7