

1. ASBESTOS-CONTAINING MATERIALS ARE PRESENT IN ACCESSIBLE AND INACCESSIBLE INTERSTITIAL SPACES THROUGHOUT THIS BUILDING.
2. MATERIALS CONTAINING <1% ASBESTOS ARE PRESENT THROUGHOUT THE BUILDING. SEE HAZARDOUS MATERIALS SURVEY AND SPECIFICATION 02 82 21 FOR ADDITIONAL INFORMATION.
3. ALL CONTRACTORS PERFORMING DEMOLITION ACTIVITIES ARE TO COMPLY WITH ALL APPLICABLE LEAD PAINT REGULATIONS IN OAR 437-DIVISION 3, 1926.62 AND SECTION 02 83 19 OF THE SPECIFICATIONS.
4. CONTRACTOR IS TO COORDINATE ALL ABATEMENT ACTIVITIES WITH CONSTRUCTION MANAGER/GENERAL CONTRACTOR INCLUDING BUT NOT LIMITED TO: SCHEDULING, PHASING, ACCESS, AND SECURITY, POWER AND WATER NEEDS, PROTECT AND SAVE ITEMS, LOCKOUT/TAGOUT PROCEDURES AND SITE SAFETY REQUIREMENTS.
5. THIS DRAWING IS DIAGRAMMATIC AND SHOULD BE USED FOR GENERAL MATERIAL INFORMATION AND SAMPLE LOCATIONS ONLY. CONTRACTOR IS TO FIELD VERIFY ALL MATERIAL LOCATIONS AND QUANTITIES.










1. APPROXIMATELY 5,000 OF ASBESTOS-CONTAINING ROOFING DEBRIS AND CONTAMINATED BLOW-IN INSULATION IS TO BE REMOVED FROM ATTIC SPACES THROUGHOUT. SEE SPECIFICATION 02 82 13 FOR ADDITIONAL INFORMATION.
2. ADDITIONAL ASBESTOS-CONTAINING FLOORING IS PRESUMED TO EXIST UNDER WALL PLATES AND CASEWORK THROUGHOUT. CONTRACTOR IS TO FULLY REMOVE ALL ASBESTOS FLOORING THROUGHOUT.
3. ADDITIONAL ASBESTOS-CONTAINING PIPE INSULATION LIKELY TO EXIST ABOVE CEILINGS, WITHIN WALLS, IN TUNNELS, AND IN INTERSTITIAL SPACES THROUGHOUT. CONTRACTOR TO LOCATE AND REMOVE ALL ASBESTOS PIPE INSULATION.
4. APPROXIMATELY 300 MERCURY VAPOR LIGHT TUBES AND 20 PCB-CONTAINING LIGHTING BALLASTS TO BE REMOVED.
5. CARPETING OVERLIES ASBESTOS FLOORING IN MOST LOCATIONS.
6. ADDITIONAL ASBESTOS-CONTAINING BOILER, TANK, AND PIPE INSULATION TO BE REMOVED FROM BASEMENT LEVEL SEE SPECIFICATION 02 82 13 FOR QUANTITIES.
7. ADDITIONAL ISOLATED AREAS OF MERCURY VAPOR LIGHT TUBE DEBRIS TO BE REMOVED FROM LOCATIONS THROUGHOUT.

- ① MERCURY VAPOR LIGHT TUBE DEBRIS TO BE REMOVED.
- ② WET WALL WITH PRESUMED ASBESTOS-CONTAINING PIPE INSULATION TO BE REMOVED.

	ASBESTOS-CONTAINING FLOOR TILE AND MASTIC TO BE REMOVED
	TWO-LAYERS OF ASBESTOS-CONTAINING FLOOR TILE AND MASTIC TO BE REMOVED
	THREE-LAYERS OF ASBESTOS-CONTAINING FLOOR TILE AND MASTIC TO BE REMOVED
	ASBESTOS-CONTAINING FLOOR TILE AND MASTIC UNDER NON-ASBESTOS SHEET FLOORING TO BE REMOVED
	WAINSCOTING WITH ASBESTOS-CONTAINING MASTIC TO BE REMOVED

007 — DRAWING REFERENCE TO BULK SAMPLE FIELD CODE,  
SEE INVENTORY OF SAMPLES


— MATERIAL SYMBOL

NOT TESTED	NEGATIVE -	POSITIVE +	
			THERMAL SYSTEM INSULATION
			SURFACING MATERIAL
			MISCELLANEOUS MATERIAL


DRAWING REFERENCE	FIELD CODE	LAB RESULT	MATERIAL SAMPLED
001	23514.174-0001	(-)	GLUED-ON CEILING TILES
002	23514.174-0002	(-)	WALL AND CEILING PLASTER
003	23514.174-0003	(+)	MASTIC
004	23514.174-0004	(-/-)	COVEBASE/MASTIC
005	23514.174-0005	(+)	MASTIC
006	23514.174-0006	(+(<1%))	VINYL FLOOR TILE/MASTIC
007	23514.174-0007	(-/-)	VINYL FLOOR TILE/MASTIC

DRAWING REFERENCE	FIELD CODE	LAB RESULT	MATERIAL SAMPLED
◇ 008	23514.174-0008	(-)	MORTAR
◇ 009	23514.174-0009	(-)	BLOWN-IN INSULATION
◇ 010	23514.174-0010	(-)	BLOWN-IN INSULATION
◇ 011	23514.174-0011	(-)	BLOWN-IN INSULATION
◇ 012	23514.174-0012	(-/-/-/-)	PAPER FELT
◇ 013	23514.174-0013	(-)	MECHANICAL ISOLATION CLOTH
□ 014	23514.174-0014	(-)	TEXTURED CEILING MATERIAL
◇ 015	23514.174-0015	(-/-)	VINYL FLOOR TILE/MASTIC
◇ 016	23514.174-0016	(-/-)	CERAMIC TILE/GROUT
■ 017	23514.174-0017	(<1%)	SINK UNDERCOATING
◇ 018	23514.174-0018	(-)	WALL AND CEILING PLASTER
◇ 019	23514.174-0019	(-/-)	LAY-IN CEILING TILE
□ 020	23514.174-0020	(-)	SINK UNDERCOATING
◇ 021	23514.174-0021	(-/-/-/-)	VINYL FLOOR TILE/MASTIC
◇ 022	23514.174-0022	(-)	TEXTURED CEILING MATERIAL
◇ 023	23514.174-0023	(-/-/-)	GLUED-ON CEILING TILES

DRAWING REFERENCE	FIELD CODE	LAB RESULT	MATERIAL SAMPLED
◆ 024	23514.174-0024	(-<1%/-)	MASTIC
◆ 025	23514.174-0025	(-/-/-)	SHEET FLOOR COVERING
◆ 026	23514.174-0026	(+/-)	VINYL FLOOR TILE/MASTIC
◆ 027	23514.174-0027	(+/-)	BUILT-UP ROOFING
◆ 028	23514.174-0028	(<1%)	CAULK
◆ 029	23514.174-0029	(-/-)	BRICK & MORTAR
◆ 030	23514.174-0030	(+)	CAULK
◆ 031	23514.174-0031	(-)	CONCRETE COATING
◆ 035	23514.174-0035	(-)	WINDOW GLAZING COMPOUND
◆ 039	23514.174-0039	(-)	CONCRETE ROOFING
◆ 040	23514.174-0040	(-/-)	WALL AND CEILING PLASTER
◆ 041	23514.174-0041	(-/-/-)	WALL AND CEILING PLASTER
◆ 042	23514.174-0042	(-/-/-)	GYPSUM WALLBOARD/ JOINT COMPOUND
◆ 043	23514.174-0043	(<1%/-)	WALL AND CEILING PLASTER
◆ 044	23514.174-0044	(-/-/-)	WALL AND CEILING PLASTER
◆ 045	23514.174-0045	(-/-)	WALL AND CEILING PLASTER

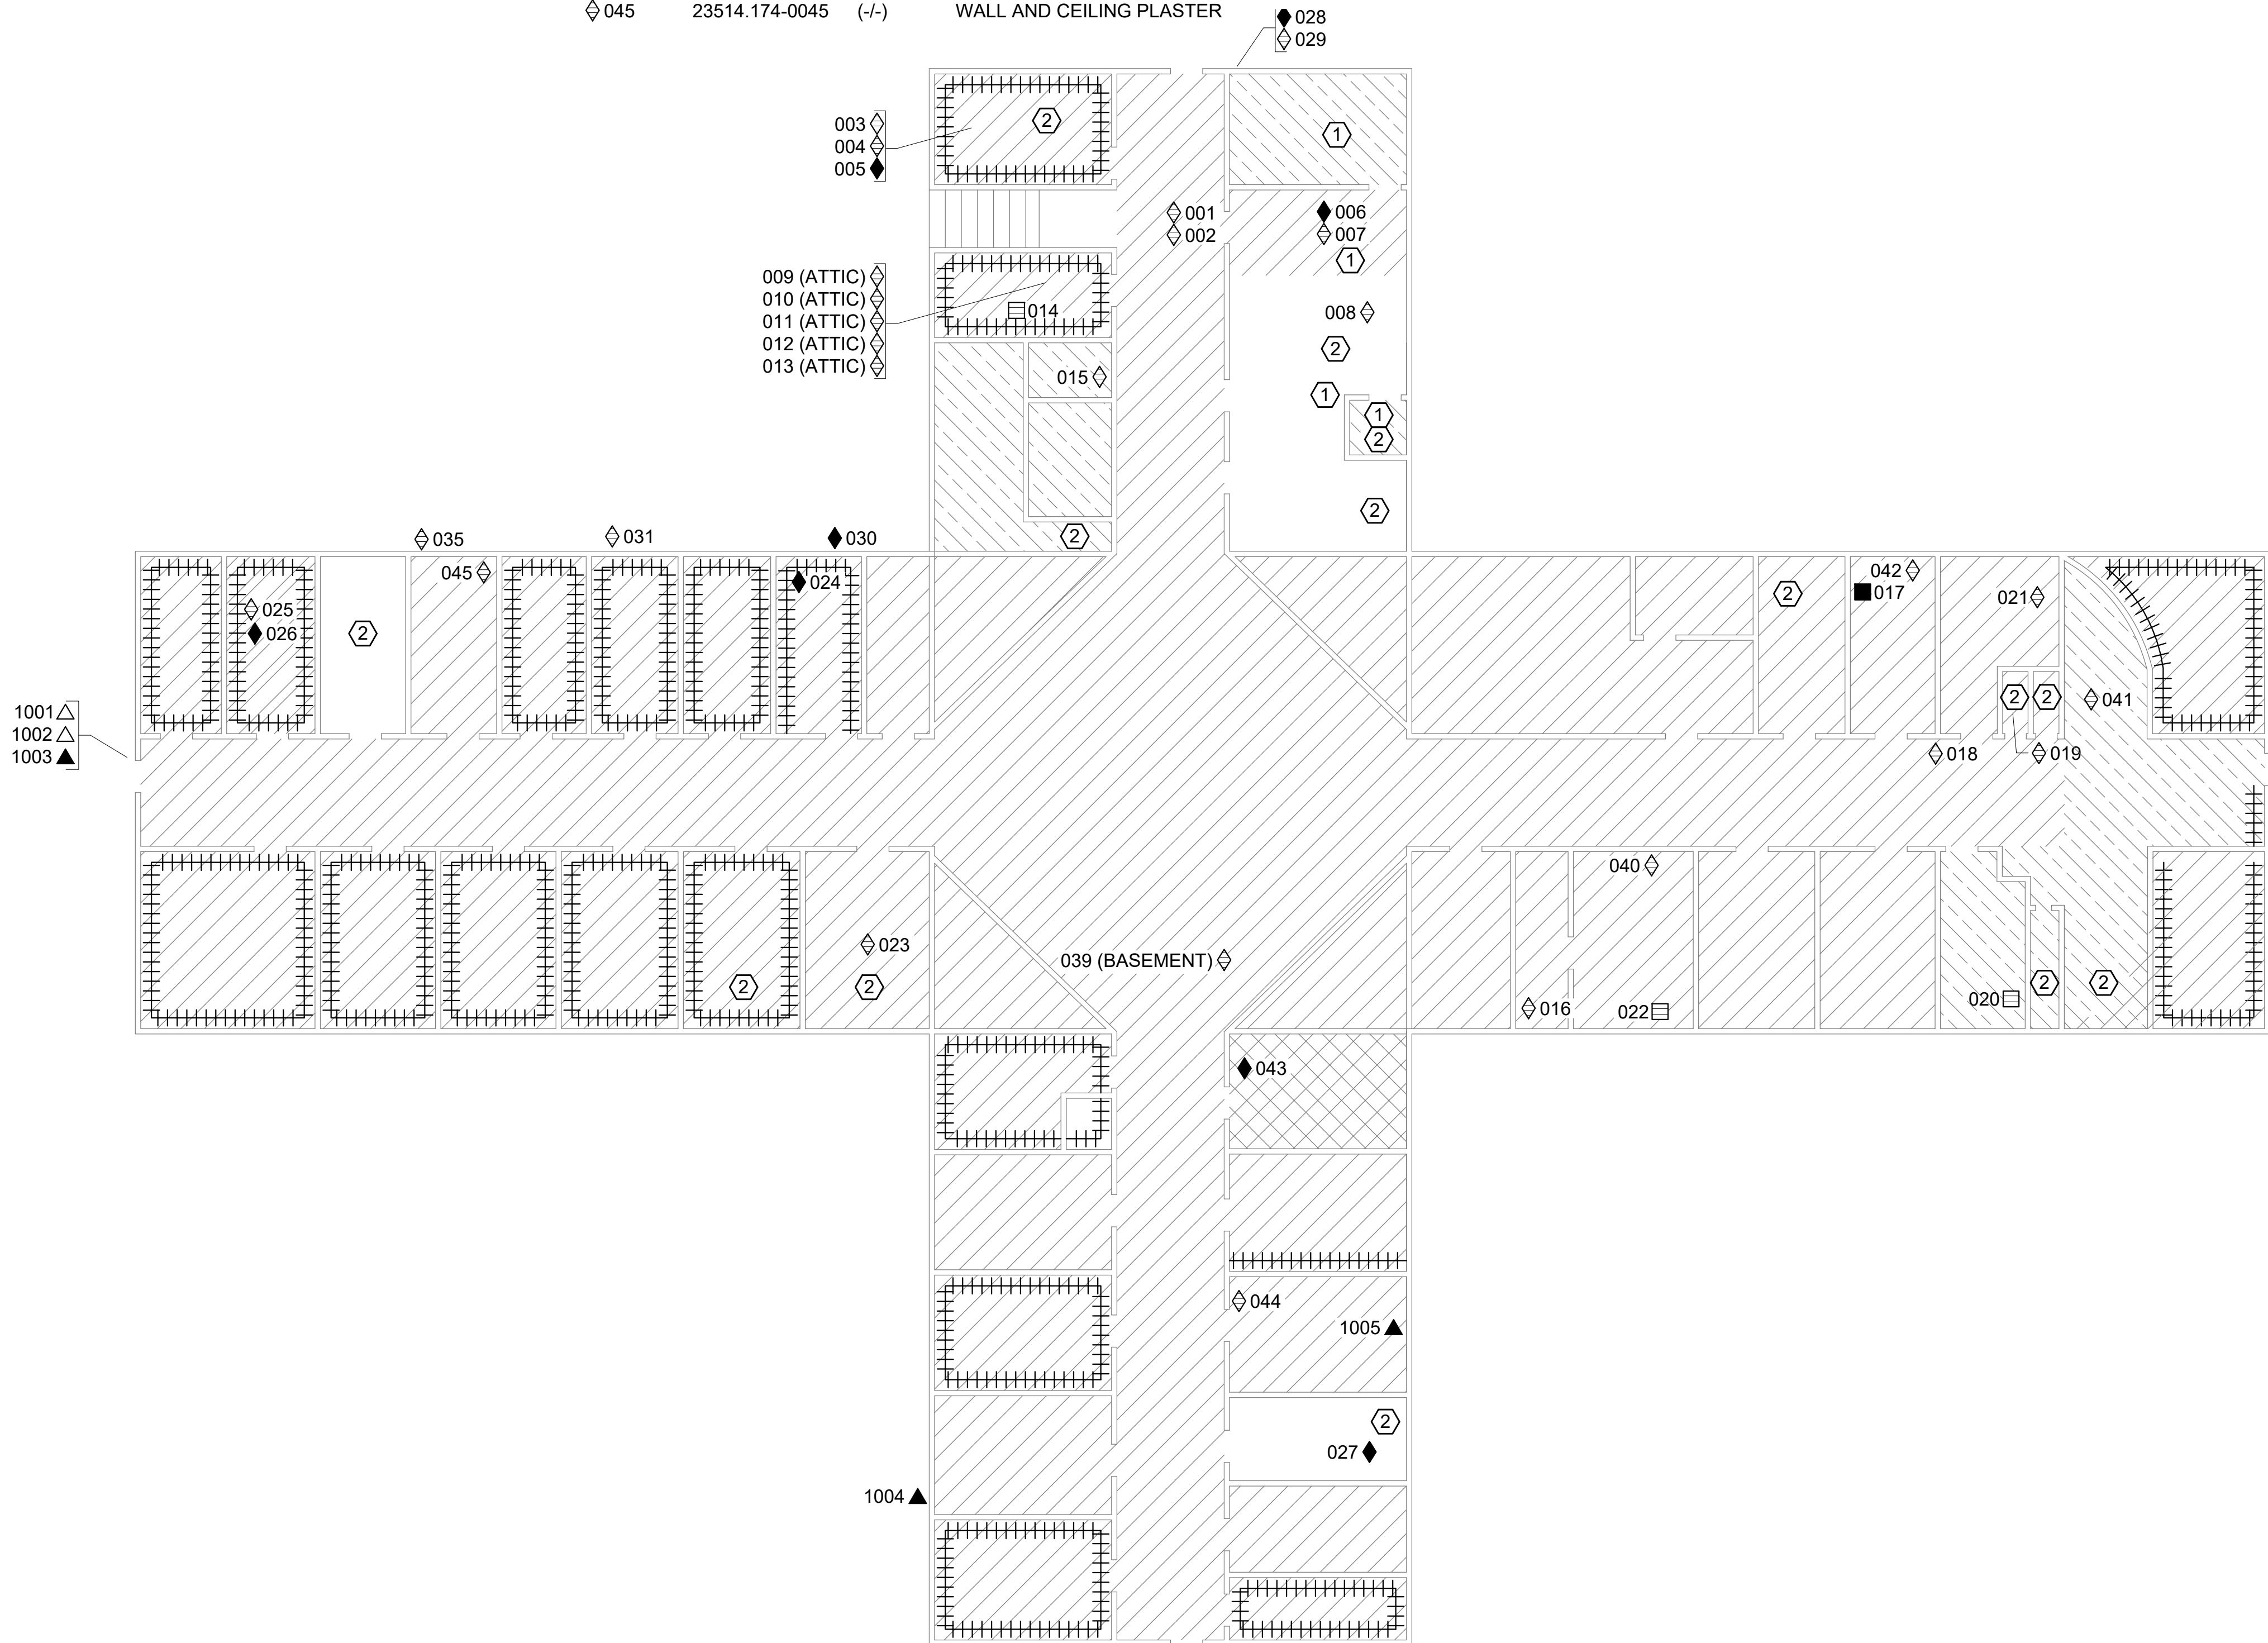

### FIRST FLOOR PLAN - BUILDING "F"

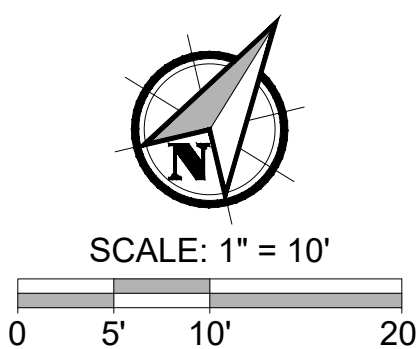

PREPARED FOR: PORTLAND PUBLIC SCHOOLS

[illegible]